



ITEM NO.	PART NUMBER	DESCRIPTION	DESCRIPTION 2	QTY
1	FB-264-4000-2	BEAM, PULTRUDED STOCK	SERIES 4000 x 264 in, GRAY	1
2	TG0813-0053	BUSHING	13/16 in x 5-1/4 in	3
3	TG0813-0054	BUSHING	13/16 in x 3-1/4 in	4
4	FOAM	-	-	1
5	EC40-0006-2	END CAP	SERIES 4000, GRAY	2
6	DM-0006	MOUNT ASSEMBLY, DEADEND	4KLH	2
7	HB0750-0003	HEX BOLT	3/4 in - 10 x 6 in	4
8	LW0750-0001	LOCK WASHER	3/4 in	7
9	HN0750-0001	HEX NUT	3/4 in - 10	4
10	SW0813-0005	SQUARE WASHER	13/16 in, 4 in x 3/8 in	6
11	EN0750-0002	EYE NUT	3/4 in - 10	6
12	TR0750-0003	THREADED ROD	3/4 in - 10 x 9-1/2 in	3

PUPPI®
www.pupicrossarms.com


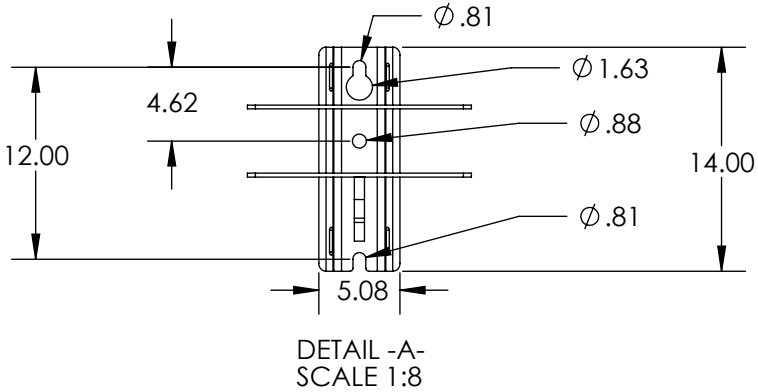


0.3



REVISIONS				
REV.	DESCRIPTION	DATE	INITIALS	ECO
0.1	REMOVE NOTE 2	2013-09-25	BRH	
0.2	UPDATE DRAWING FORMAT	2016-09-14	RAF	
0.3	CLEAN CORRUPTION WITHIN FILE	2016-11-15	RAF	
0.4	ADD LOAD RATINGS	2017-09-14	AJH	3610
0.5	CORRECTED LOAD RATING VALUES	2018-06-27	JCW	
0.6	UPDATE LOAD NOTE ROUNDING AND ADD NOTE #5	2020-12-29	NDH	5078
1.0	UPDATE VERTICAL LOAD NOTE	2022-03-07	NDH	5490
2.0	UPDATE LOAD NOTES	2023-03-14	NDH	6038

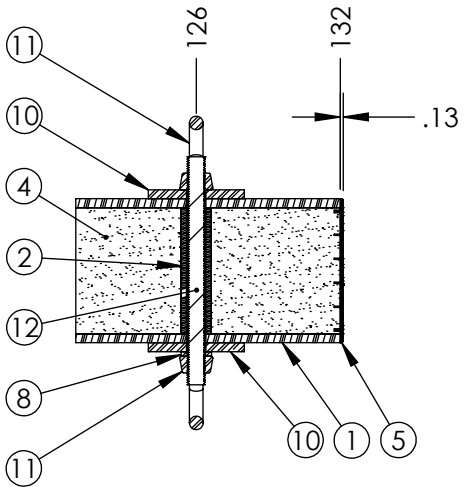

SECTION A-A
SCALE 1 : 8

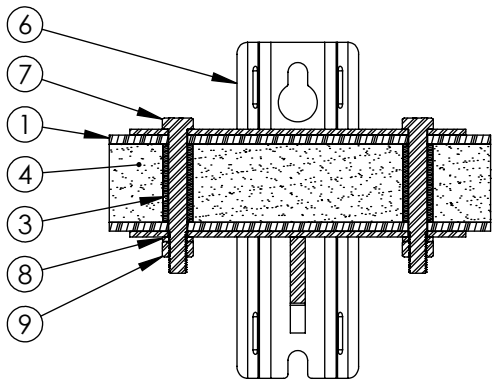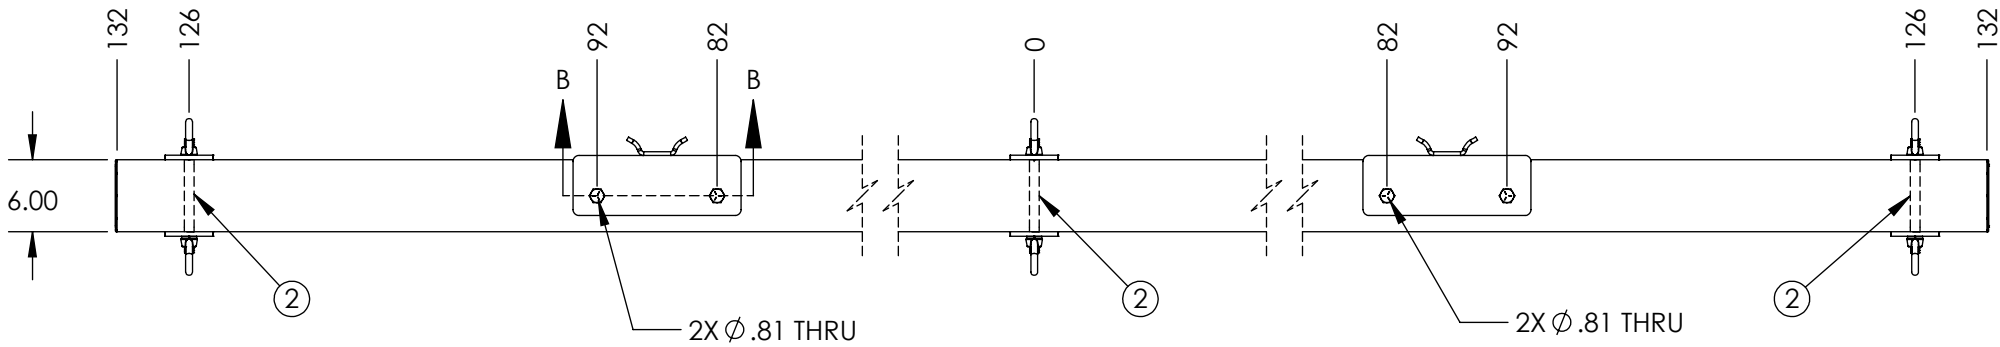

SECTION B-B
SCALE 1 : 8

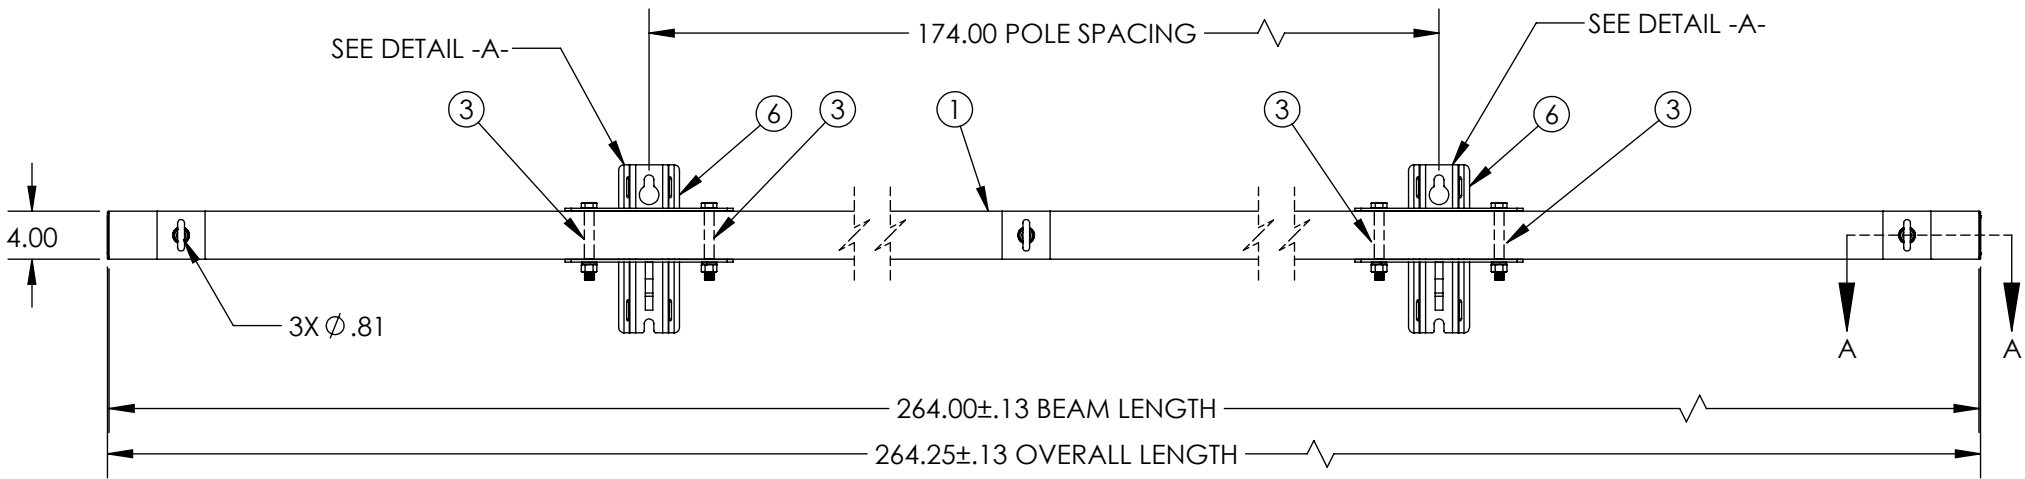

- NOTES:
1. CENTER OF MOUNT HOLE(S) TO HOLES TOLERANCE ± 0.06
 2. USE 3/4" HARDWARE TO ATTACH DEAD-END MOUNTS TO POLES **(NOT SUPPLIED BY GEOTEK)**
 3. CALCULATED AVERAGE ULTIMATE LONGITUDINAL LOAD = 19,500 LBS PER WIRE, 3 WIRES
 4. CALCULATED AVERAGE ULTIMATE VERTICAL LOAD = 8,250 LBS PER WIRE, 3 WIRES
 5. GEOTEK RECOMMENDS THAT FULLY FACTORED DESIGN TENSION AND WEIGHT PER WIRE, INCLUDING ALL OVERLOAD FACTORS, DOES NOT EXCEED 50% OF THE AVERAGE ULTIMATE STRENGTH PER WIRE OF THE CROSSARM

0.5 0.6 1.0 2.0

---UNLESS OTHERWISE SPECIFIED---		
DIMENSIONS ARE IN INCHES		
INTERPRET DIM AND TOL PER ASME Y14.5-2009		
ANGULAR: MACH $\pm 2^\circ$		
BEND $\pm 2^\circ$		
ONE PLACE DECIMAL ± 0.1		
TWO PLACE DECIMAL ± 0.02		
STATE: RELEASED 2023-05-11		
DRAWN: RAF 2013-04-23		
CHECKED: CJM 2023-05-09		
APPROVED: NDH 2023-05-11		
REPLACES:		
THIRD ANGLE PROJECTION		
CUSTOMER SIGNATURE:		
DATE:		



1421 SECOND AVE NW
STEWARTVILLE, MN 55976
(800) 533-1680
www.geotekinc.com

DESCRIPTION: DEADEND ASSEMBLY, SERIES 4000 264 in, RUS 42		
SIZE: DWG. NO. B DD4000264E342H2	BEAM COLOR: GRAY	REV: 2.0
SCALE: 1:16 WEIGHT: 187 LBS		SHEET 1 OF 1