

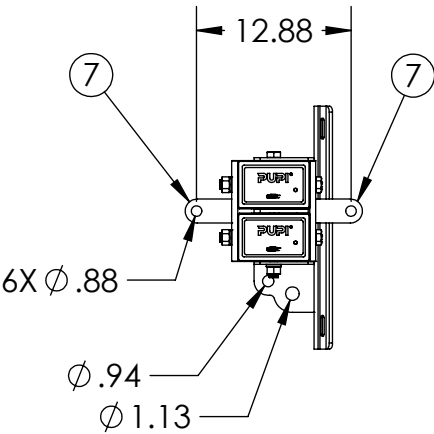
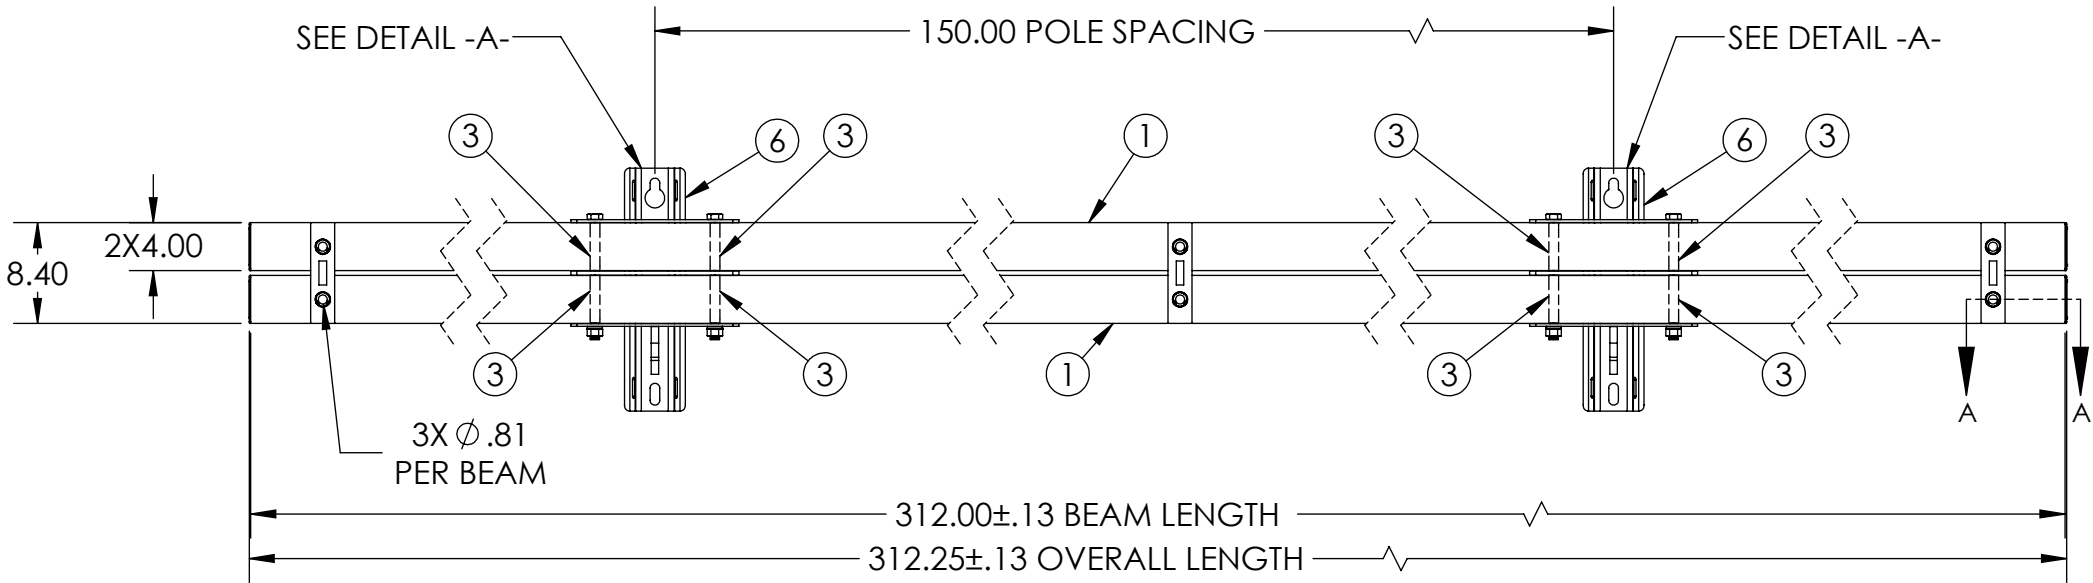



ITEM NO.	PART NUMBER	DESCRIPTION	DESCRIPTION 2	QTY
1	FB-312-4000-2	BEAM, PULTRUDED STOCK	SERIES 4000 x 312 in, GRAY	2
2	TG0813-0053	BUSHING	13/16 in x 5-1/4 in	6
3	TG0813-0054	BUSHING	13/16 in x 3-1/4 in	8
4	FOAM	-	-	2
5	EC40-0006-2	END CAP	SERIES 4000, GRAY	4
6	DM-0038	MOUNT ASSEMBLY, DEADEND	DE2NS, SPECIAL	2
7	BK-0020	BRACKET ASSEMBLY, DE2		6
8	HB0750-0007	HEX BOLT	3/4 in - 10 x 10 in	4
9	HB0750-0006	HEX BOLT	3/4 in - 10 x 8 in	6
10	LW0750-0001	LOCK WASHER	3/4 in	10
11	HN0750-0001	HEX NUT	3/4 in - 10	10

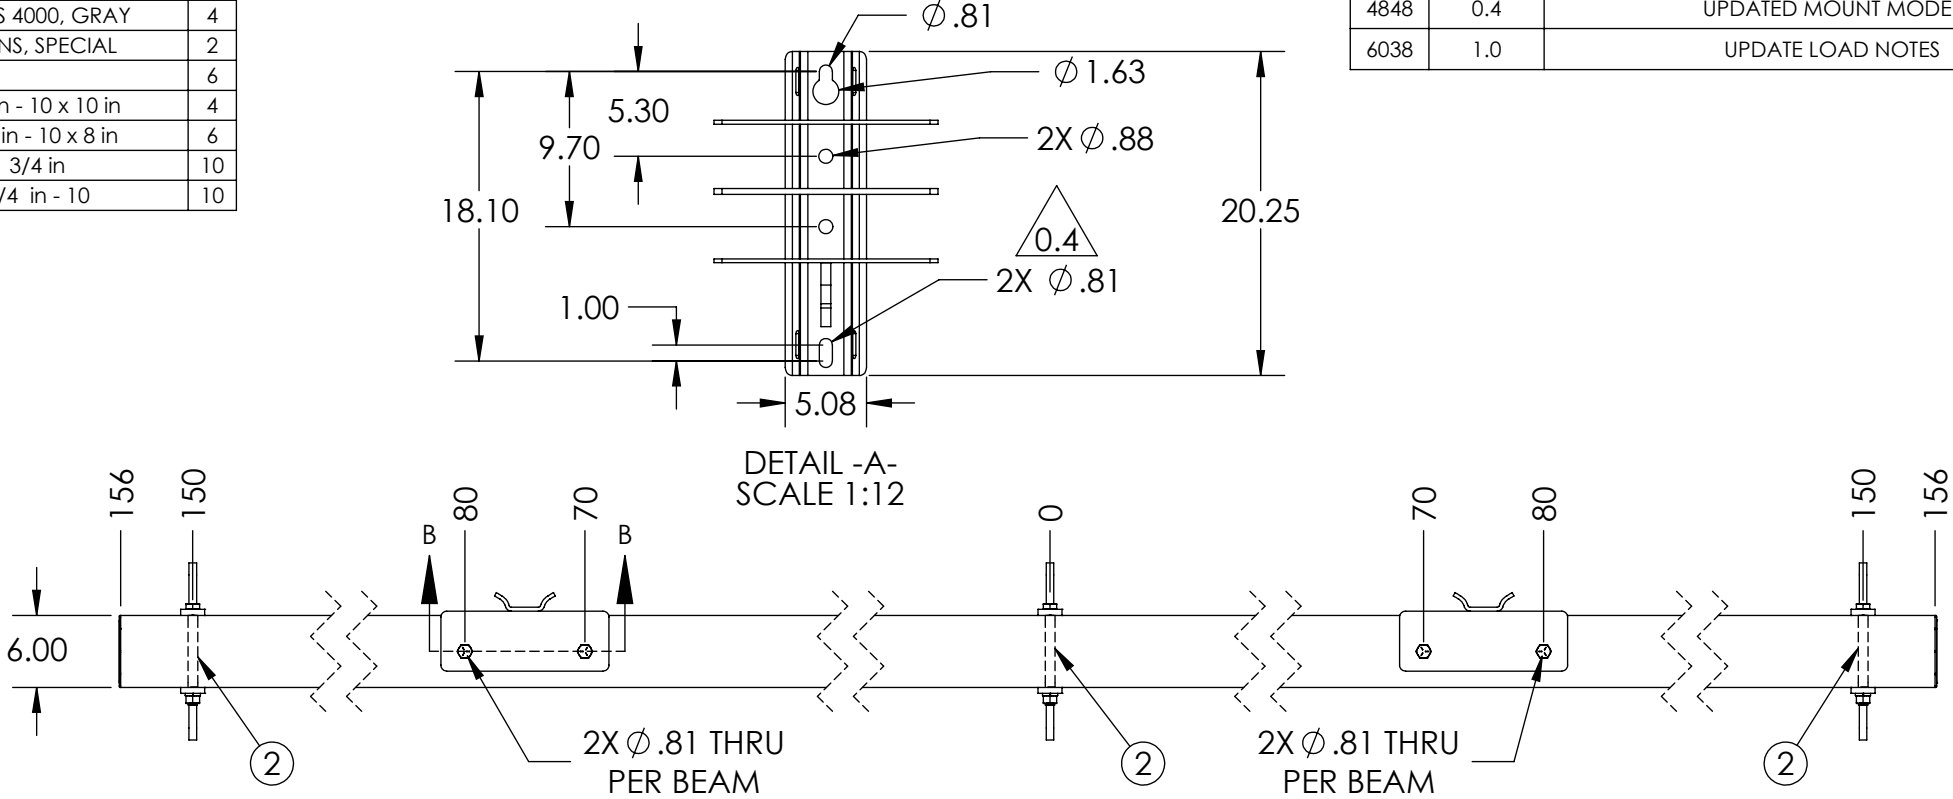


REVISIONS				
ECO	REV.	DESCRIPTION	DATE	INITIALS
1396	0.1	UPDATE DRAWING FORMAT	2016-02-02	RAF
4741	0.3	UPDATE NOTES AND MATCH REVISION LEVEL	2020-02-11	NDH
4848	0.4	UPDATED MOUNT MODEL	2020-05-19	RJS
6038	1.0	UPDATE LOAD NOTES	2023-03-13	NDH

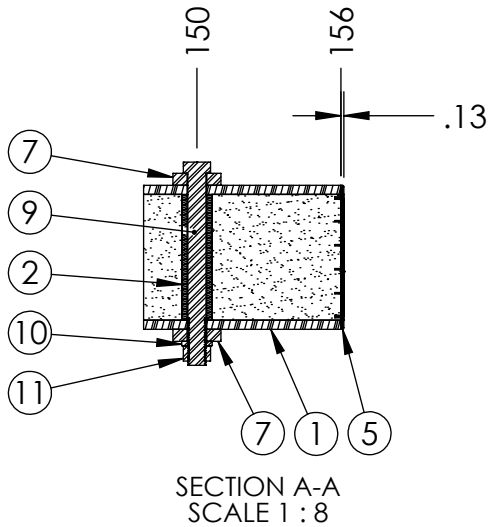

- NOTES:
- CENTER OF MOUNT HOLE(S) TO HOLES TOLERANCE ± 0.06
 - CALCULATED AVERAGE ULTIMATE VERTICAL LOAD = 10,500 LBS PER WIRE, 3 WIRES
 - CALCULATED AVERAGE ULTIMATE LONGITUDINAL LOAD = 25,250 LBS PER WIRE, 3 WIRES
 - GEOTEK RECOMMENDS THAT FULLY FACTORED DESIGN TENSION AND WEIGHT PER WIRE, INCLUDING ALL OVERLOAD FACTORS, DOES NOT EXCEED 50% OF THE AVERAGE ULTIMATE STRENGTH PER WIRE OF THE CROSSARM



---UNLESS OTHERWISE SPECIFIED--- DIMENSIONS ARE IN INCHES INTERPRET DIM AND TOL PER ASME Y14.5-2009 ANGULAR: MACH±2° BEND ±2° ONE PLACE DECIMAL ±0.1 TWO PLACE DECIMAL ±0.02	STATE:	RELEASED	2023-05-11
	DRAWN:	TRB	2015-05-12
	CHECKED:	IAB	2023-03-13
	APPROVED:	NDH	2023-05-11
	REPLACES:		
PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF GEOTEK. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF GEOTEK IS PROHIBITED.	THIRD ANGLE PROJECTION		
			
CUSTOMER SIGNATURE:		DATE:	



1421 SECOND AVE NW
STEWARTVILLE, MN 55976
(800) 533-1680
www.geotekinc.com

DESCRIPTION: DEADEND ASSEMBLY, SERIES 4000 312 in, RUS 56		
SIZE: DWG. NO. B DD4020312E356H2	BEAM COLOR: GRAY	REV: 1.0
SCALE: 1:16 WEIGHT: 397 LBS		SHEET 1 OF 1